


POOL ENCLOSURE IS ALWAYS REQUIRED (SEE PAGE 2)

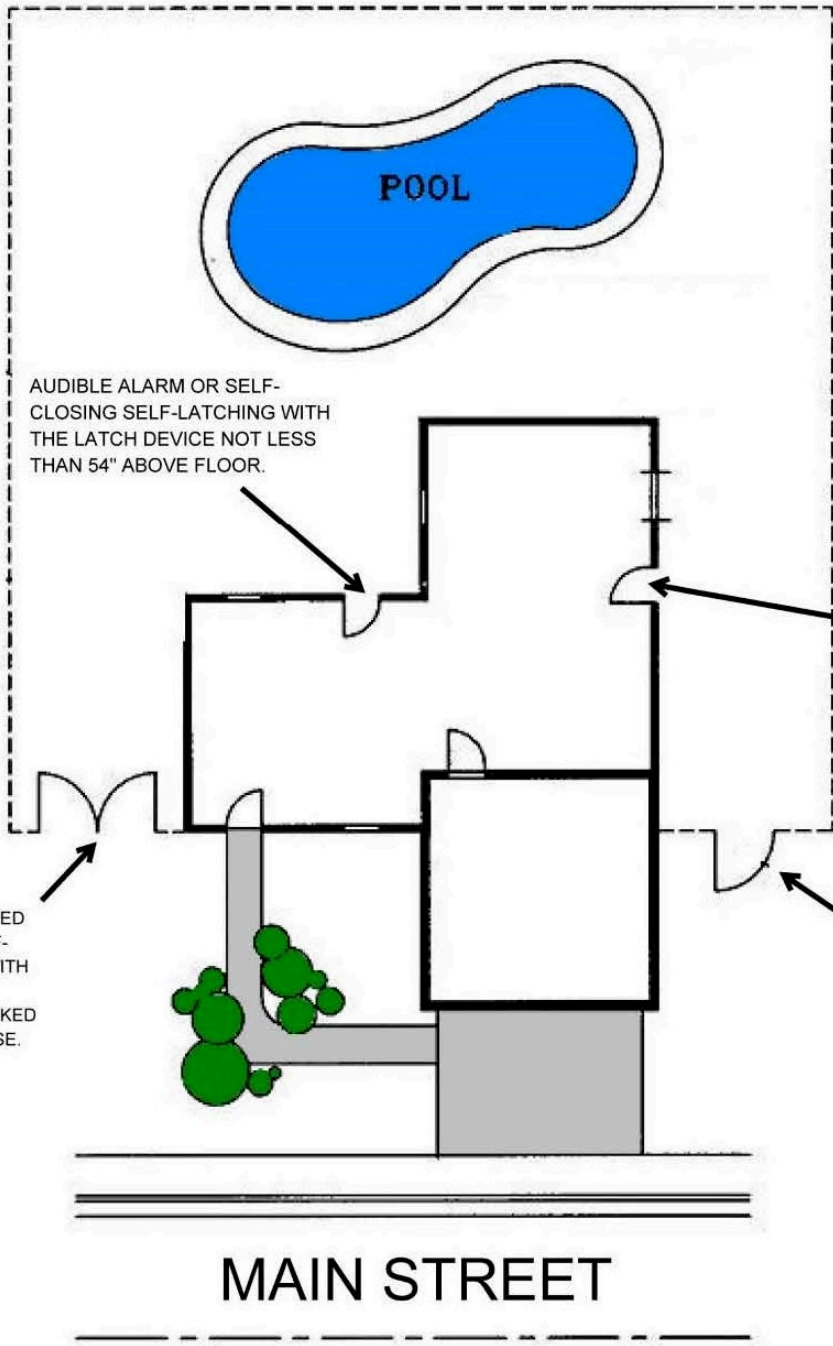

AUDIBLE ALARM OR SELF-CLOSING SELF-LATCHING WITH THE LATCH DEVICE NOT LESS THAN 54" ABOVE FLOOR.

AUDIBLE ALARM OR SELF-CLOSING SELF-LATCHING WITH THE LATCH DEVICE NOT LESS THAN 54" ABOVE FLOOR.

VEHICLE GATE IS NOT REQUIRED TO BE SELF-CLOSING OR SELF-LATCHING WHEN EQUIPPED WITH LOCKABLE HARDWARE OR PADLOCK AND REMAINED LOCKED AT ALL TIMES WHEN NOT IN USE.

ACCESS GATES SHALL NOT EXCEED 4 FEET IN WIDTH (SEE PAGE 2)


ANY ACCESS GATES THROUGH THE ENCLOSURE OPEN AWAY FROM THE SWIMMING POOL.

MAIN STREET


An alarm installed on all doors with direct access to the pool. The alarm shall sound continuously for a minimum of 30 seconds within seven seconds after the door and its screen, if present, are opened, and be capable of providing a sound pressure level of not less than 85 dBA when measured indoors at 10 feet. The alarm shall automatically reset under all conditions. The alarm system shall be equipped with a manual means, such as a touchpad or switch, to temporarily deactivate the alarm for a single opening. Such deactivation shall last no longer than 15 seconds. The deactivation switch shall be located at least 54 inches above the threshold of the door. Man door leading from garage to pool area must be self-closing and self latching with latching mechanism located a minimum of 54 inches above the threshold of the door.

BARRIER REQUIREMENTS TO BE INSTALLED AND INSPECTED PRIOR TO PLASTERING OR FILING THE POOL/SPA/HOT TUB WITH WATER

	CITY OF CHINO	
	BARRIERS FOR SWIMMING POOLS SPAS & HOT TUBS	
(909) 334-3251	13220 Central Avenue, Chino, CA 91710	
Fax (909) 334-3729	Rev. 01/2022	1 of 3

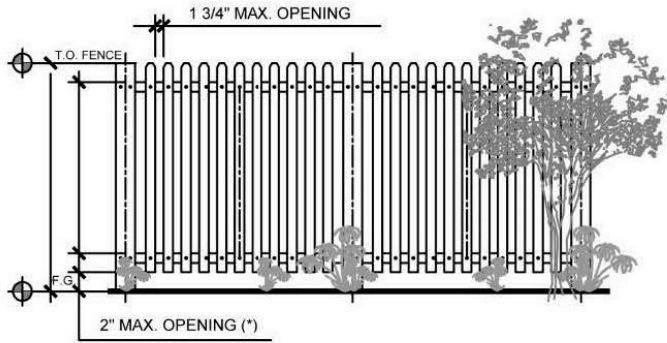


A WOOD FENCE
 IF HORIZONTAL MEMBERS ARE LESS THAN 45° APART, VERTICAL SPACING SHALL NOT EXCEED 1-3/4" AND HORIZONTAL MEMBERS SHALL BE ON THE POOL SIDE.

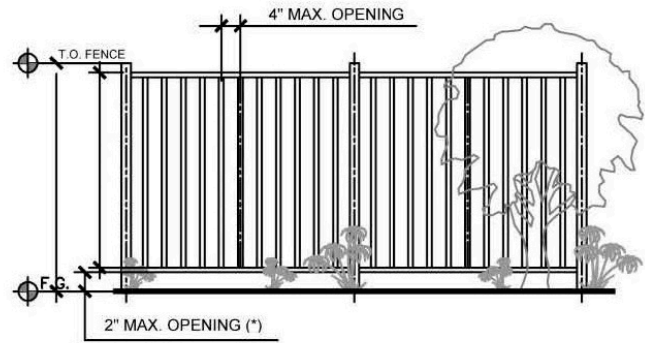


B STEEL FENCE
 IF HORIZONTAL MEMBERS ARE EQUAL OR GREATER THAN 45° APART, VERTICAL SPACING SHALL NOT EXCEED 4".

(*) NOTE FOR WOOD & STEEL FENCE: SPACING FROM GRADE LEVEL TO BOTTOM OF FENCE, MAY BE 4 INCHES IF GRADE BELOW FENCE HAS A SOLID IMPENETRABLE SURFACE SUCH AS CONCRETE.

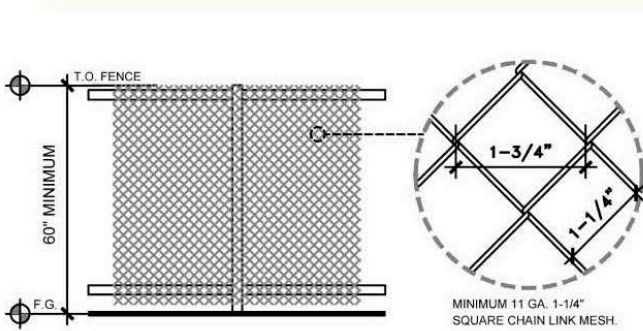


C CHAIN LINK FENCE
 IF CHAIN LINK DIMENSIONS ARE LARGER THAN SHOWN ABOVE THEN SLATS MAY BE WOVEN INTO THE CHAIN LINK MESH AND FASTENED AT THE TOP AND BOTTOM.

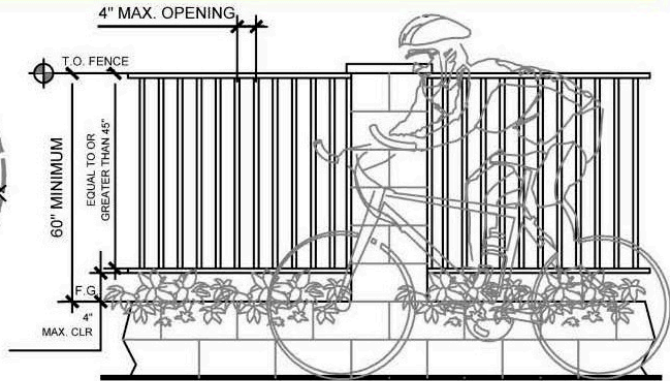


D STEEL & BLOCK FENCE


VARIOUS POOL FENCE TYPES (NOT ALL POSSIBLE FENCE DESIGNS ARE SHOWN, PLEASE CHECK WITH YOUR INSPECTOR FOR MORE INFORMATION)

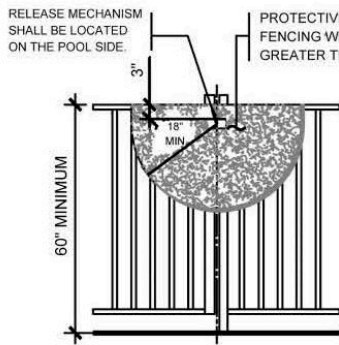

1 CONDITION 1
 RELEASE MECHANISM LOCATED LESS THAN 57" ABOVE GRADE.

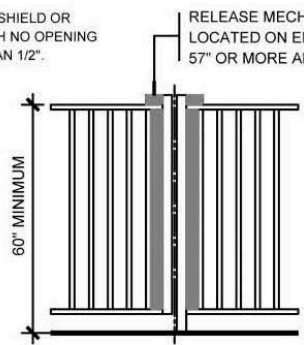

2 CONDITION 2
 RELEASE MECHANISM LOCATED 57" OR MORE ABOVE GRADE

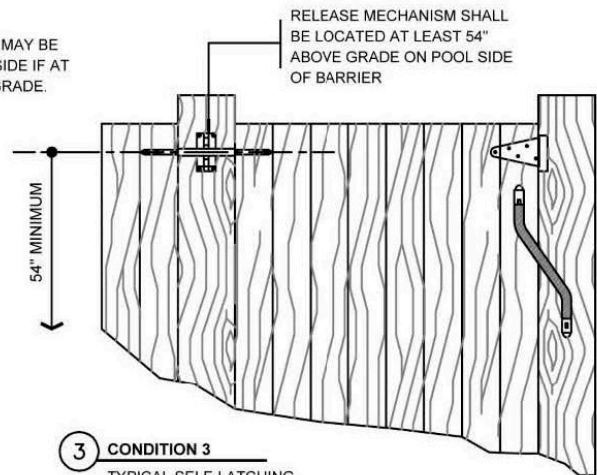


3 CONDITION 3
 TYPICAL SELF-LATCHING GATE AND SPRING CLOSER

GATE LATCHING REQUIREMENTS

NOT ALL POSSIBLE DESIGNS ARE SHOWN. PLEASE CHECK WITH YOUR INSPECTOR FOR MORE INFORMATION.

ANY ACCESS GATES THROUGH THE ENCLOSURE OPEN AWAY FROM THE SWIMMING POOL.

	CITY OF CHINO	
	BARRIERS FOR SWIMMING POOLS SPAS & HOT TUBS	
(909) 334-3251	13220 Central Avenue, Chino, CA 91710	
Fax (909) 334-3729	Rev. 01/2022	2 of 3


BARRIERS FOR SWIMMING POOLS SPAS & HOT TUBS

115922.

(a) Commencing January 1, 2007, except as provided in Section 115925, whenever a building permit is issued for construction of a new swimming pool or spa, or any building permit is issued for remodeling of an existing pool or spa, at a private, single-family home, it shall be equipped with at least **two** of the following seven drowning-prevention safety features:

1. The pool shall be isolated from access to a home by an enclosure that meets the requirements of Section 115923.
2. The pool shall incorporate removable mesh pool fencing that meets American Society for Testing and Materials (ASTM) Specifications F 2286 standards in conjunction with a gate that is self-closing and self-latching and can accommodate a key-lockable device.
3. The pool shall be equipped with an approved safety pool cover that meets all requirements of the ASTM Specifications F1346.
4. The residence shall be equipped with exit alarms on those doors providing direct access to the pool.
5. All doors providing direct access from the home to the swimming pool shall be equipped with a self-closing, self-latching device with a release mechanism placed no lower than 54 inches above the floor.
6. Swimming pool alarms that, when placed in pools, will sound upon detection of accidental or unauthorized entrance into the water. These pool alarms shall meet and be independently certified to the ASTM Standard F 2208 "Standards Specification for Pool Alarms" which includes surface motion, pressure, sonar, laser, and infrared type alarms. For purposes of this article, "swimming pool alarms" shall not include swimming protection alarm devices designed for individual use, such as an alarm attached to a child that sounds when the child exceeds a certain distance or becomes submerged in water.
7. Other means of protection, if the degree of protection afforded is equal to or greater than that afforded by any of the devices set forth above and have been independently verified by an approved testing laboratory as meeting standards for those devices established by the ASTM or the American Society of Mechanical Engineers (ASME).

(b) Prior to the issuance of any final approval for the completion of permitted construction or remodeling work, the local building code official shall inspect the drowning safety prevention devices required by this act and if no violations are found, shall give final approval.

	CITY OF CHINO
	BARRIERS FOR SWIMMING POOLS SPAS & HOT TUBS
(909) 334-3251	13220 Central Avenue, Chino, CA 91710
Fax (909) 334-3729	Rev. 01/2022 3 of 3